


105U-G-5W

Installation Guide

IMPORTANT NOTICE

PLEASE REFER TO THE USER MANUAL FOR IMPORTANT REGULATORY AND SAFETY INFORMATION PRIOR TO INSTALLATION AND USE OF THIS PRODUCT

Aerial Installation

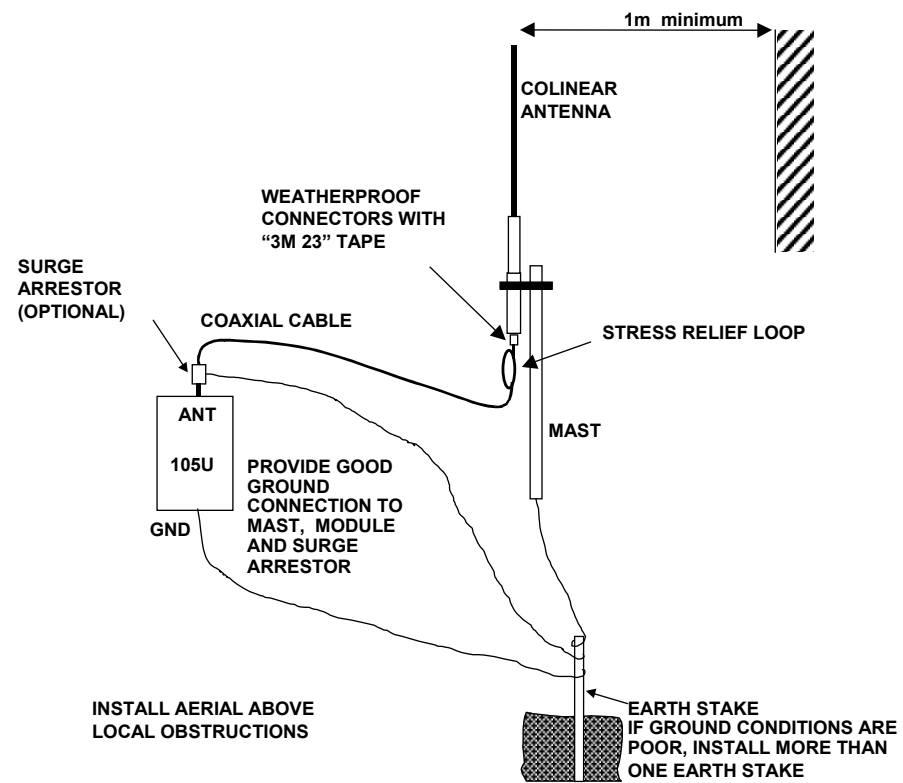

ANTENNA INSTALLATION
Antennas should be installed by experienced contractors.

105U-G I/O Installation

- Power supply:
- (A) 12-24VAC 2.5A CSA Certified Class 2
 - (B) 9-30VDC 2.5A CSA Certified Class 2
 - (C) 13.8V Lead Acid Battery or Gel-cell

Choose option and wire as shown

WARNING !

EXPLOSION HAZARD

DO NOT DISCONNECT WHILE CIRCUIT IS LIVE UNLESS AREA IS KNOWN TO BE NON HAZARDOUS

NOTES

1. DIO channels can be wired as either inputs or outputs.
2. All I/O must be SELV.

CAUTION!

For continued protection against risk of fire, replace the module fuse only with the same type and rating

